


Hall A General Power Distribution Model

(Page 1 of 4)








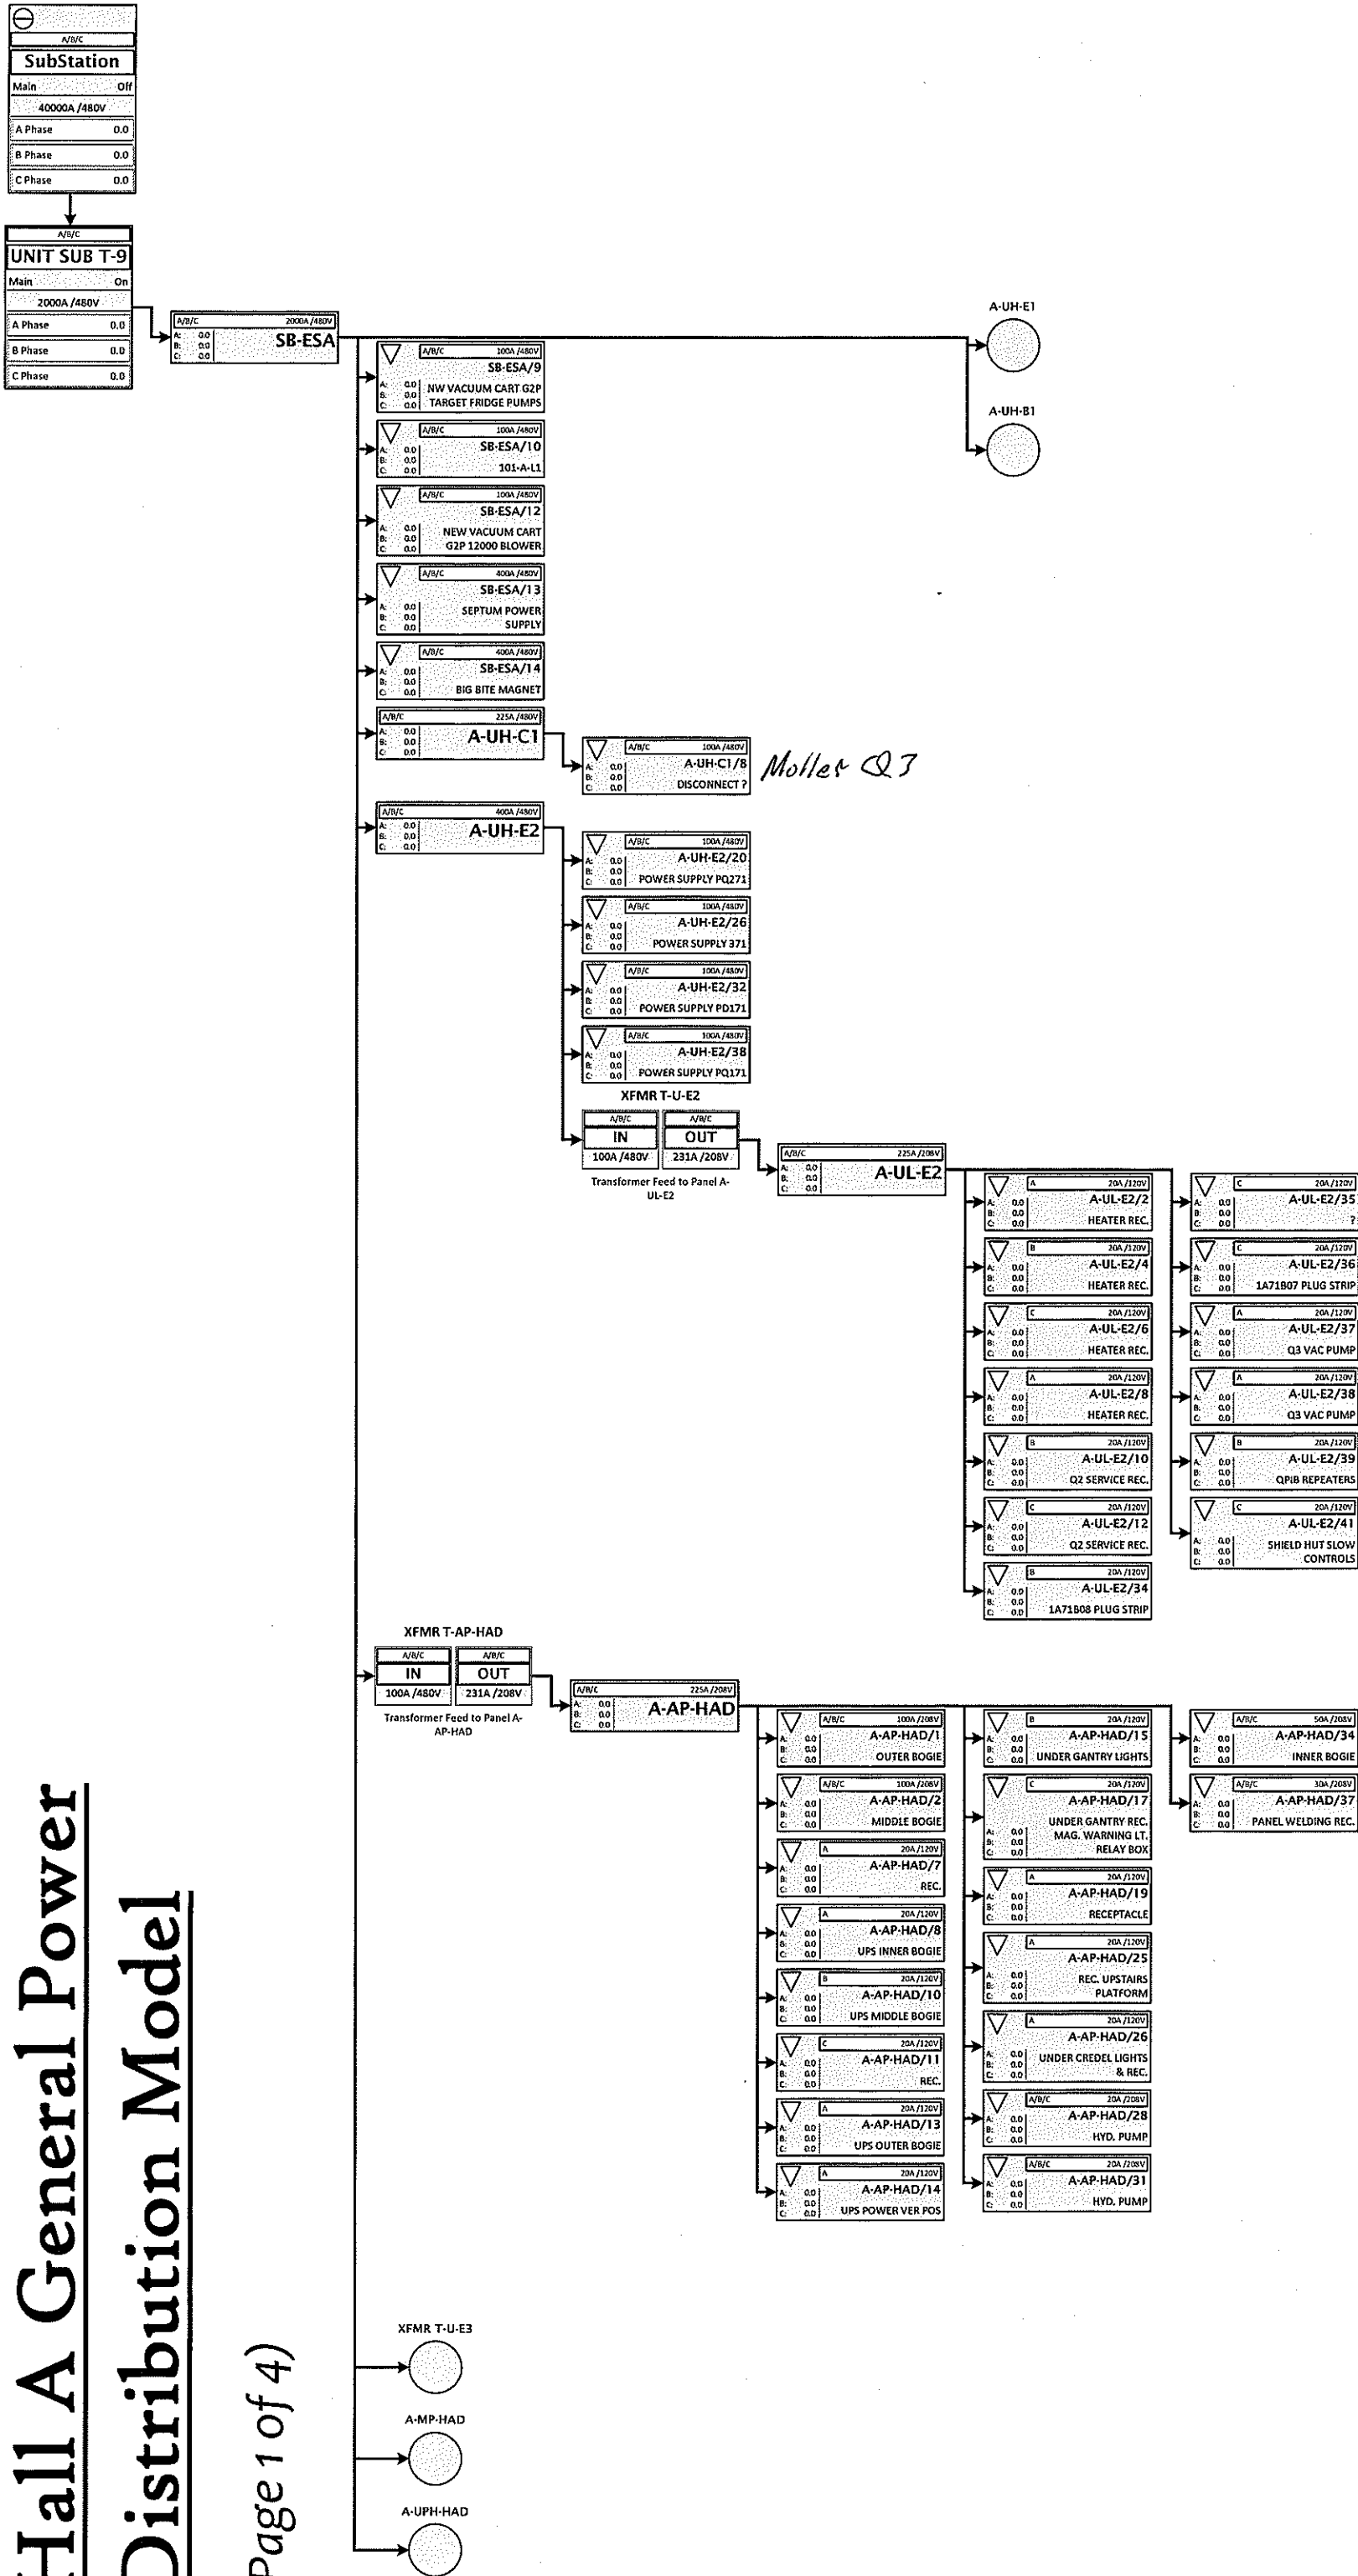


Hall A General Power Distribution Model

(Page 2 of 4)

SB-ESA


XFMRT-U-E3

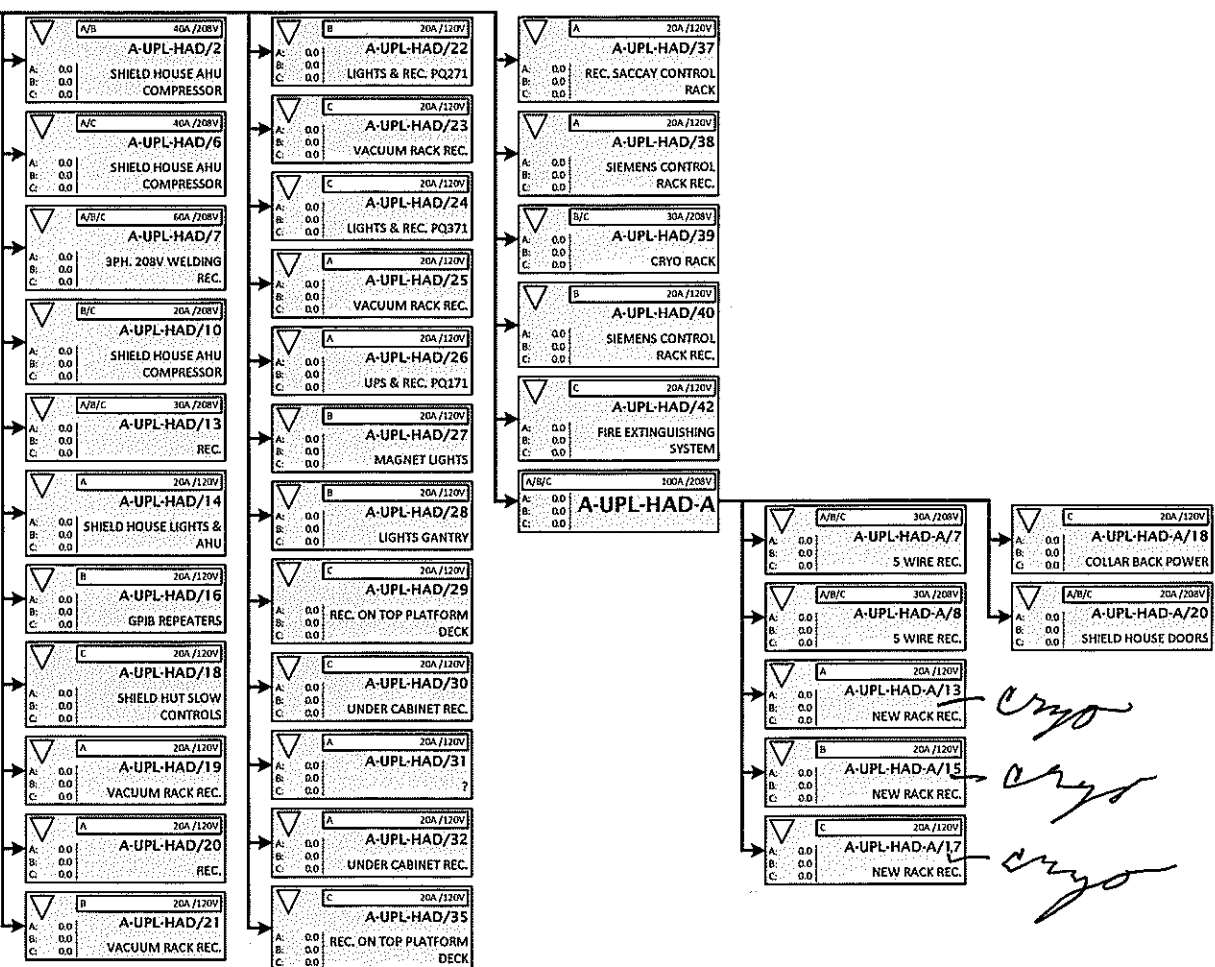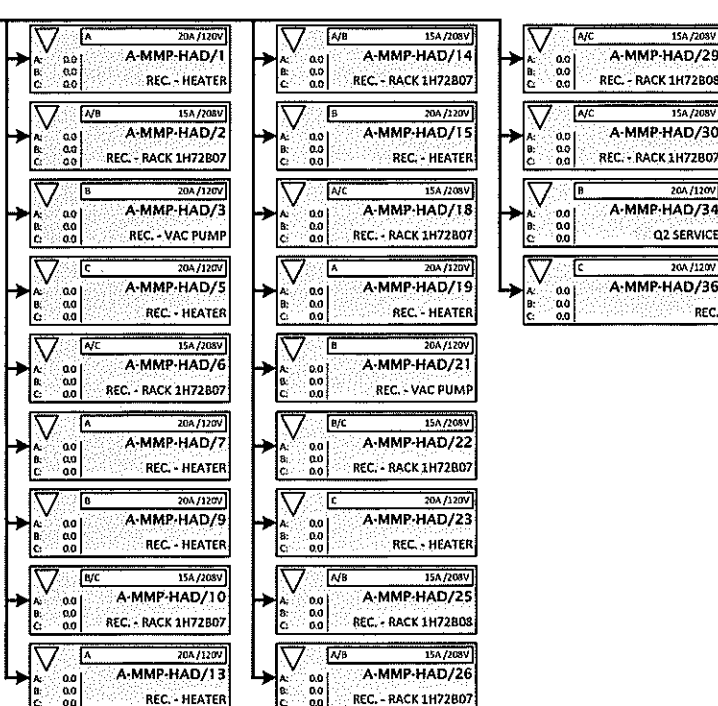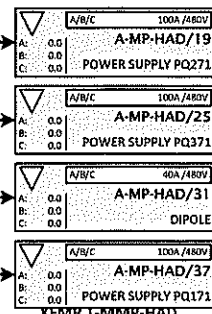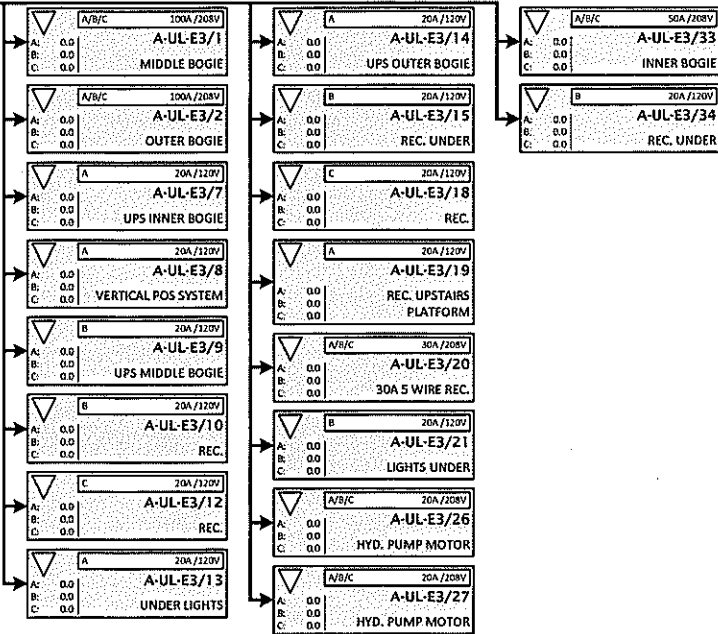

Handwritten notes:
cryo
cryo
cryo


Hall A General Power Distribution Model

(Page 3 of 4)

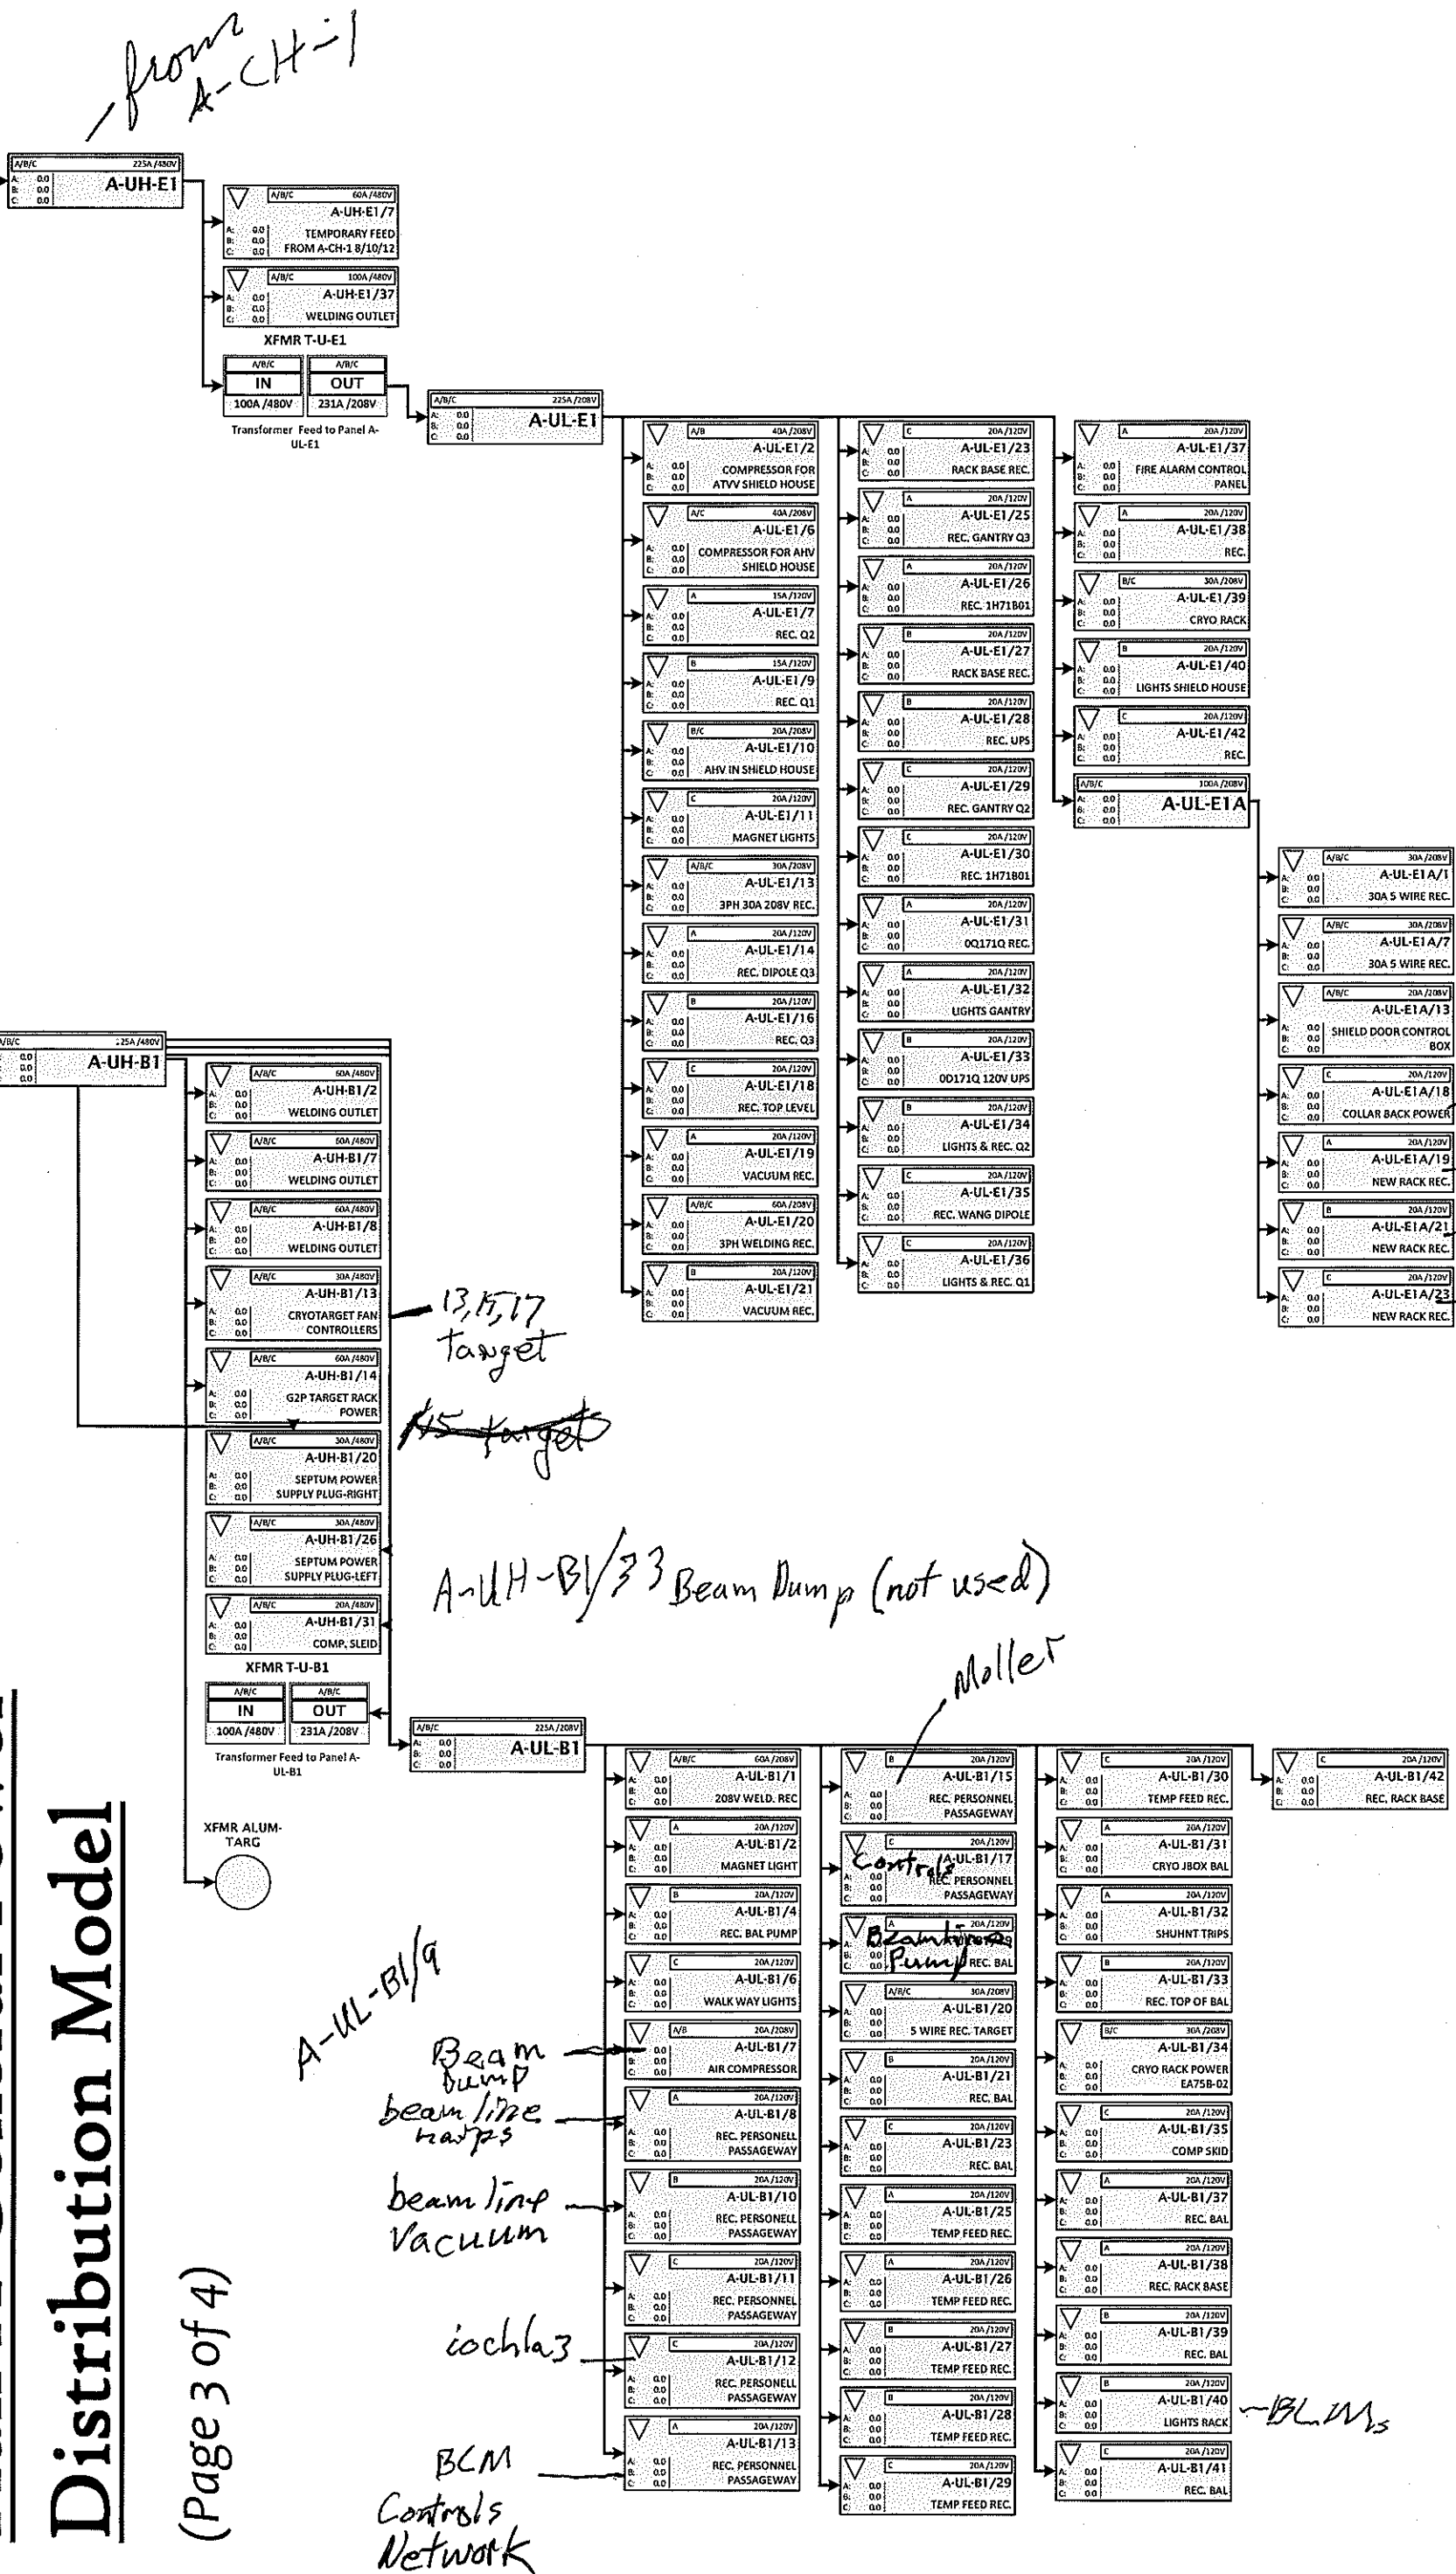


Hall A General Power Distribution Model

(Page 4 of 4)

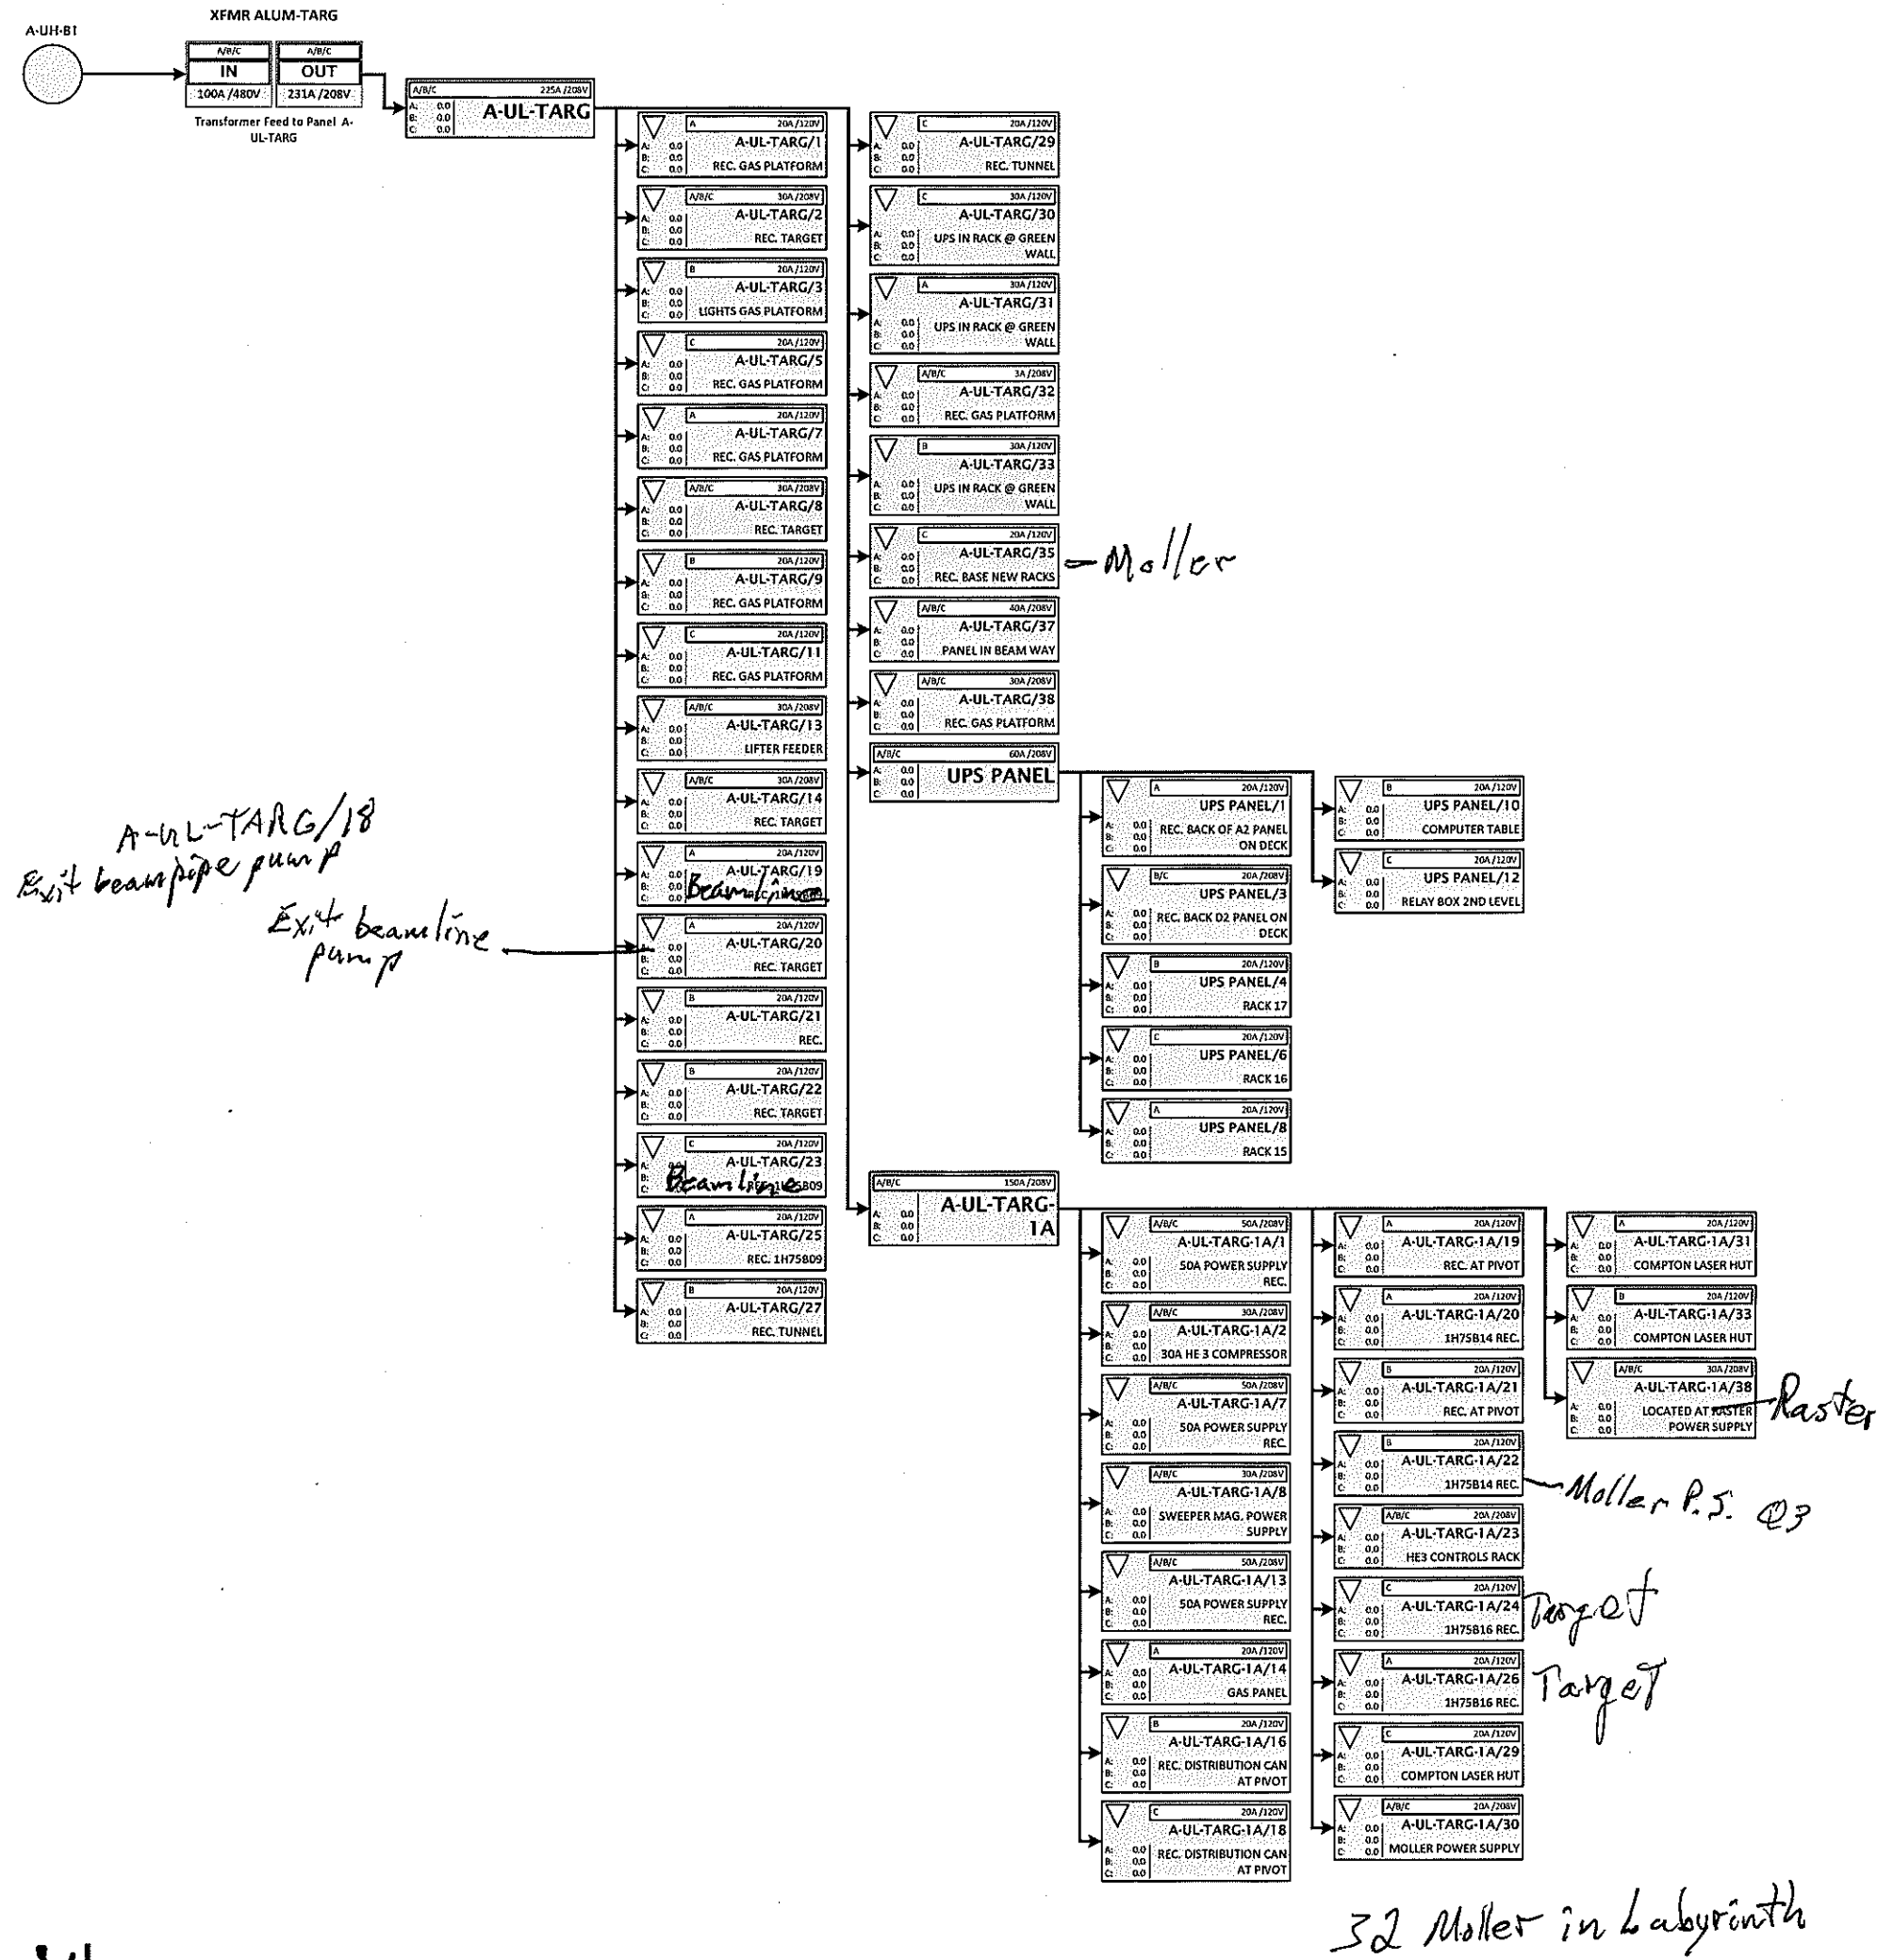


Hall A Clean Power Distribution Model

(Page 1 of 2)

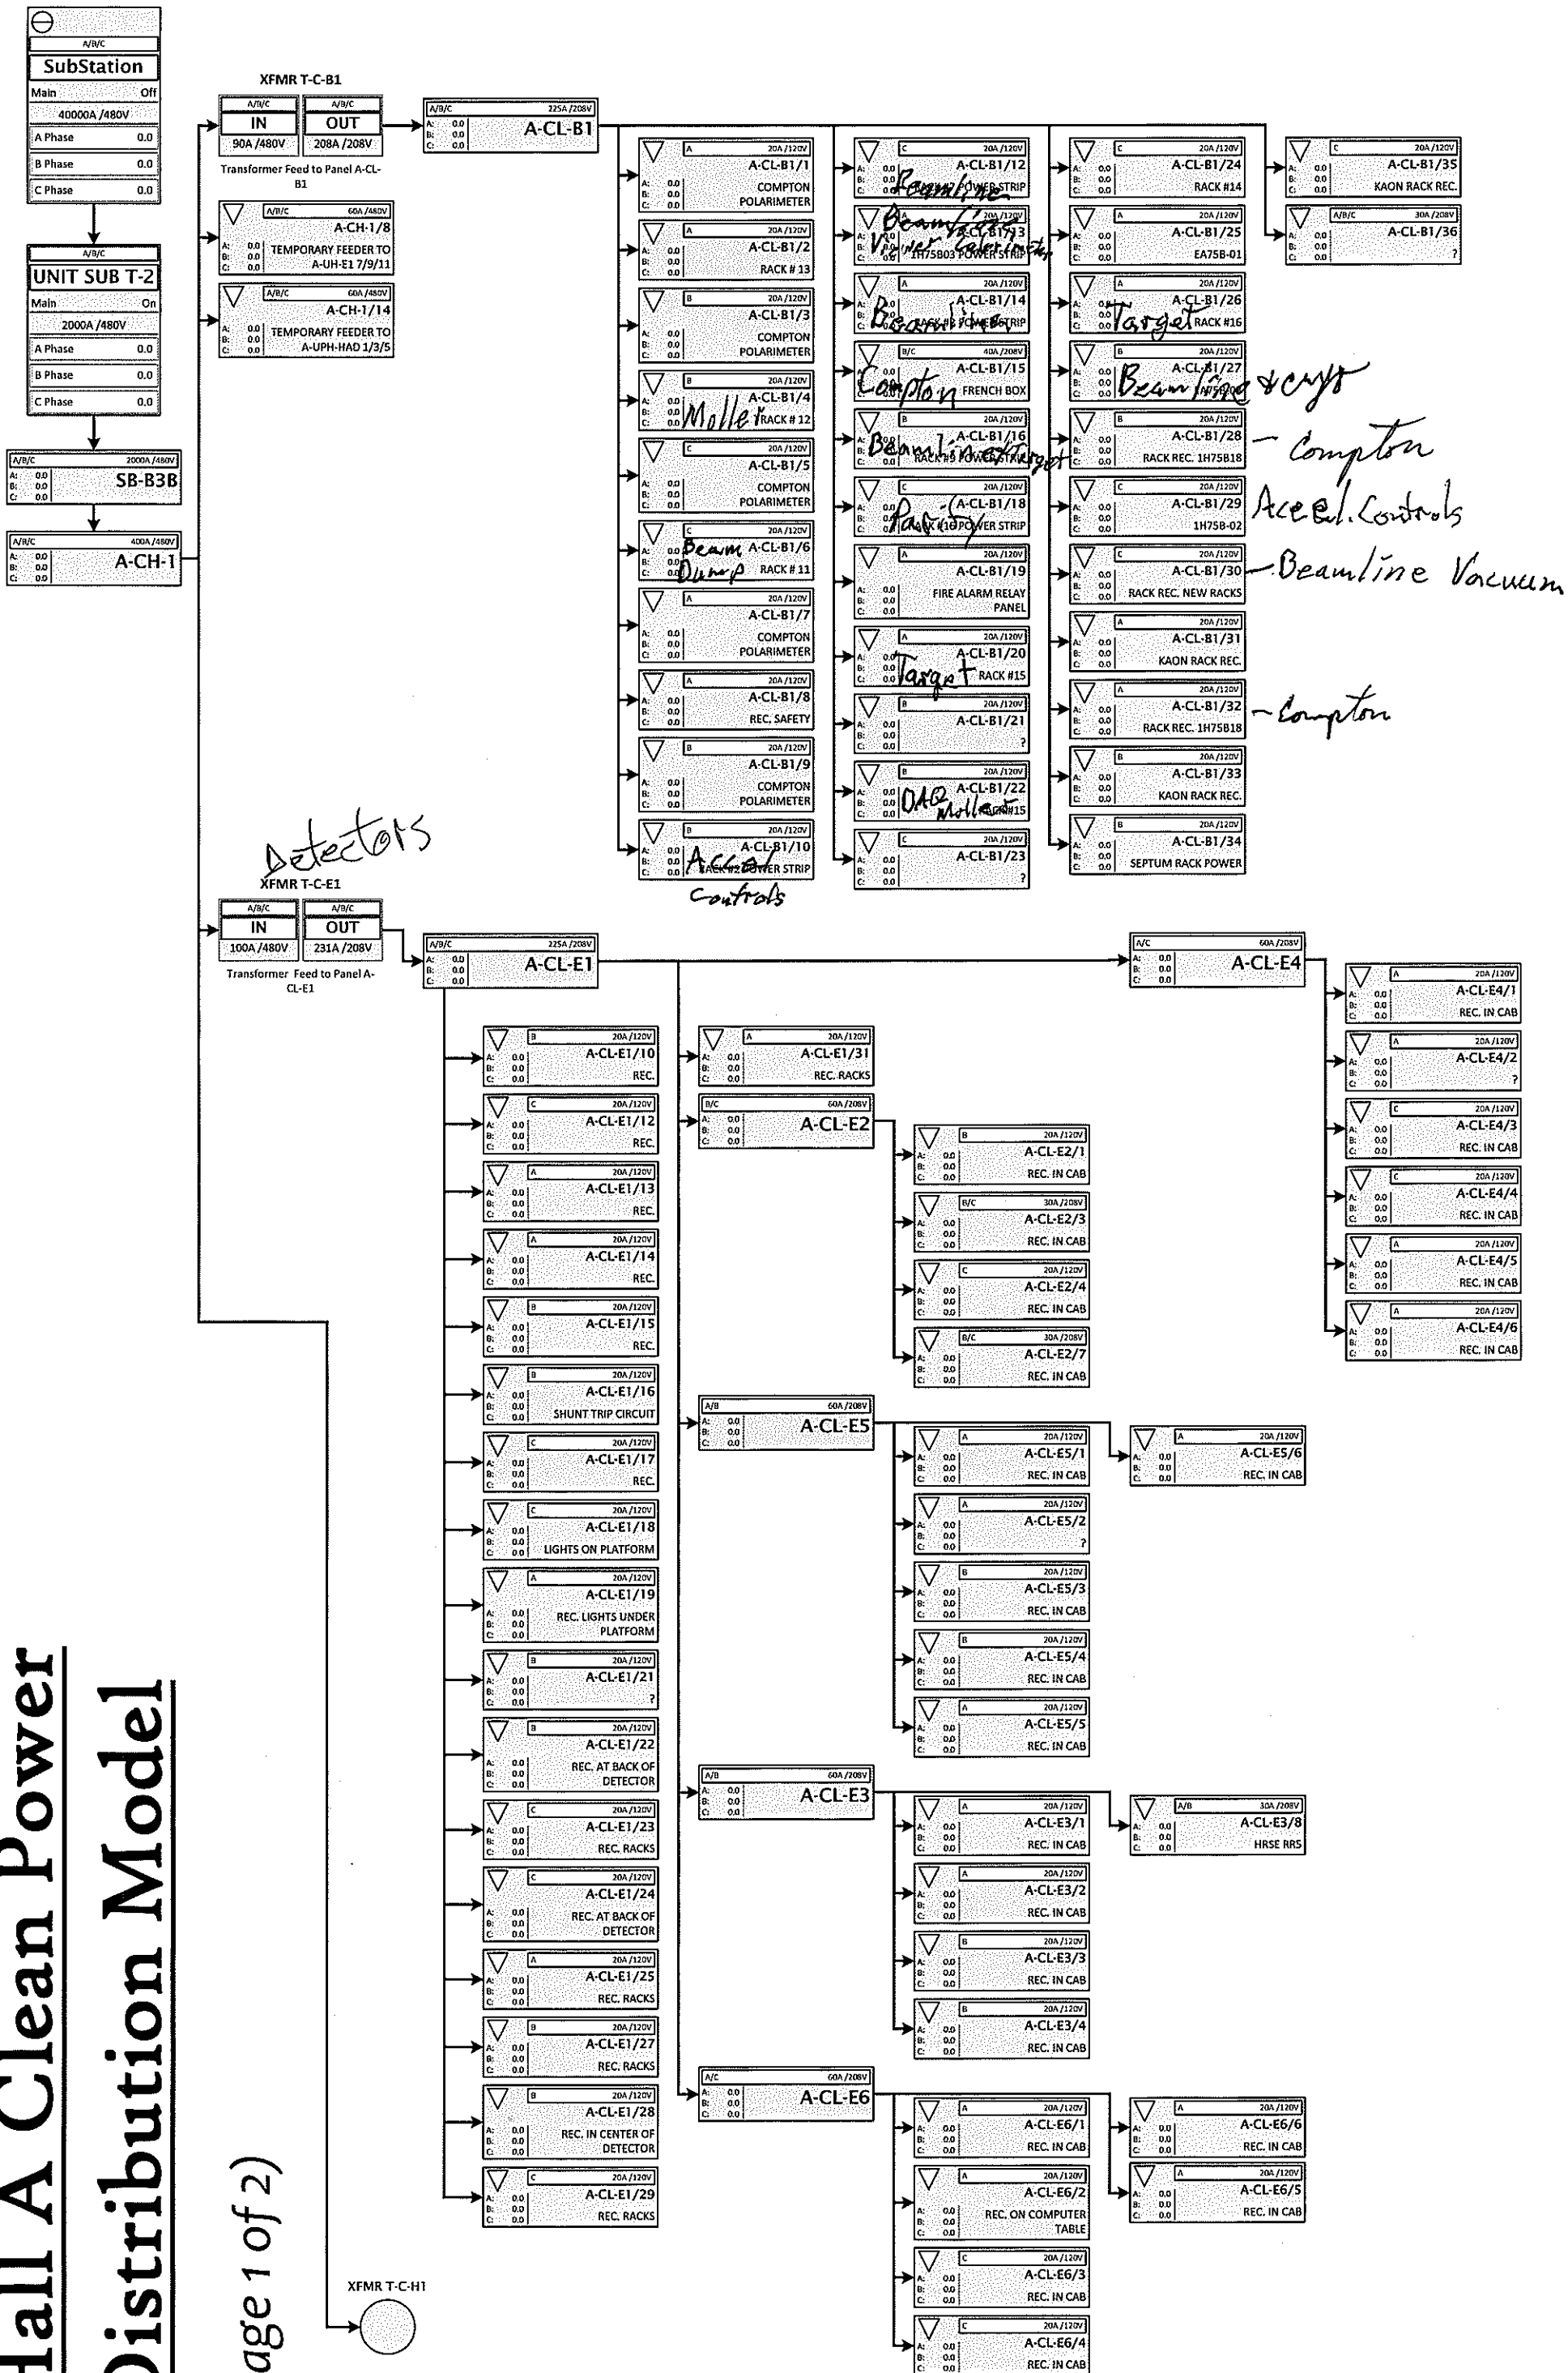


Hall A Clean Power Distribution Model

(Page 2 of 2)

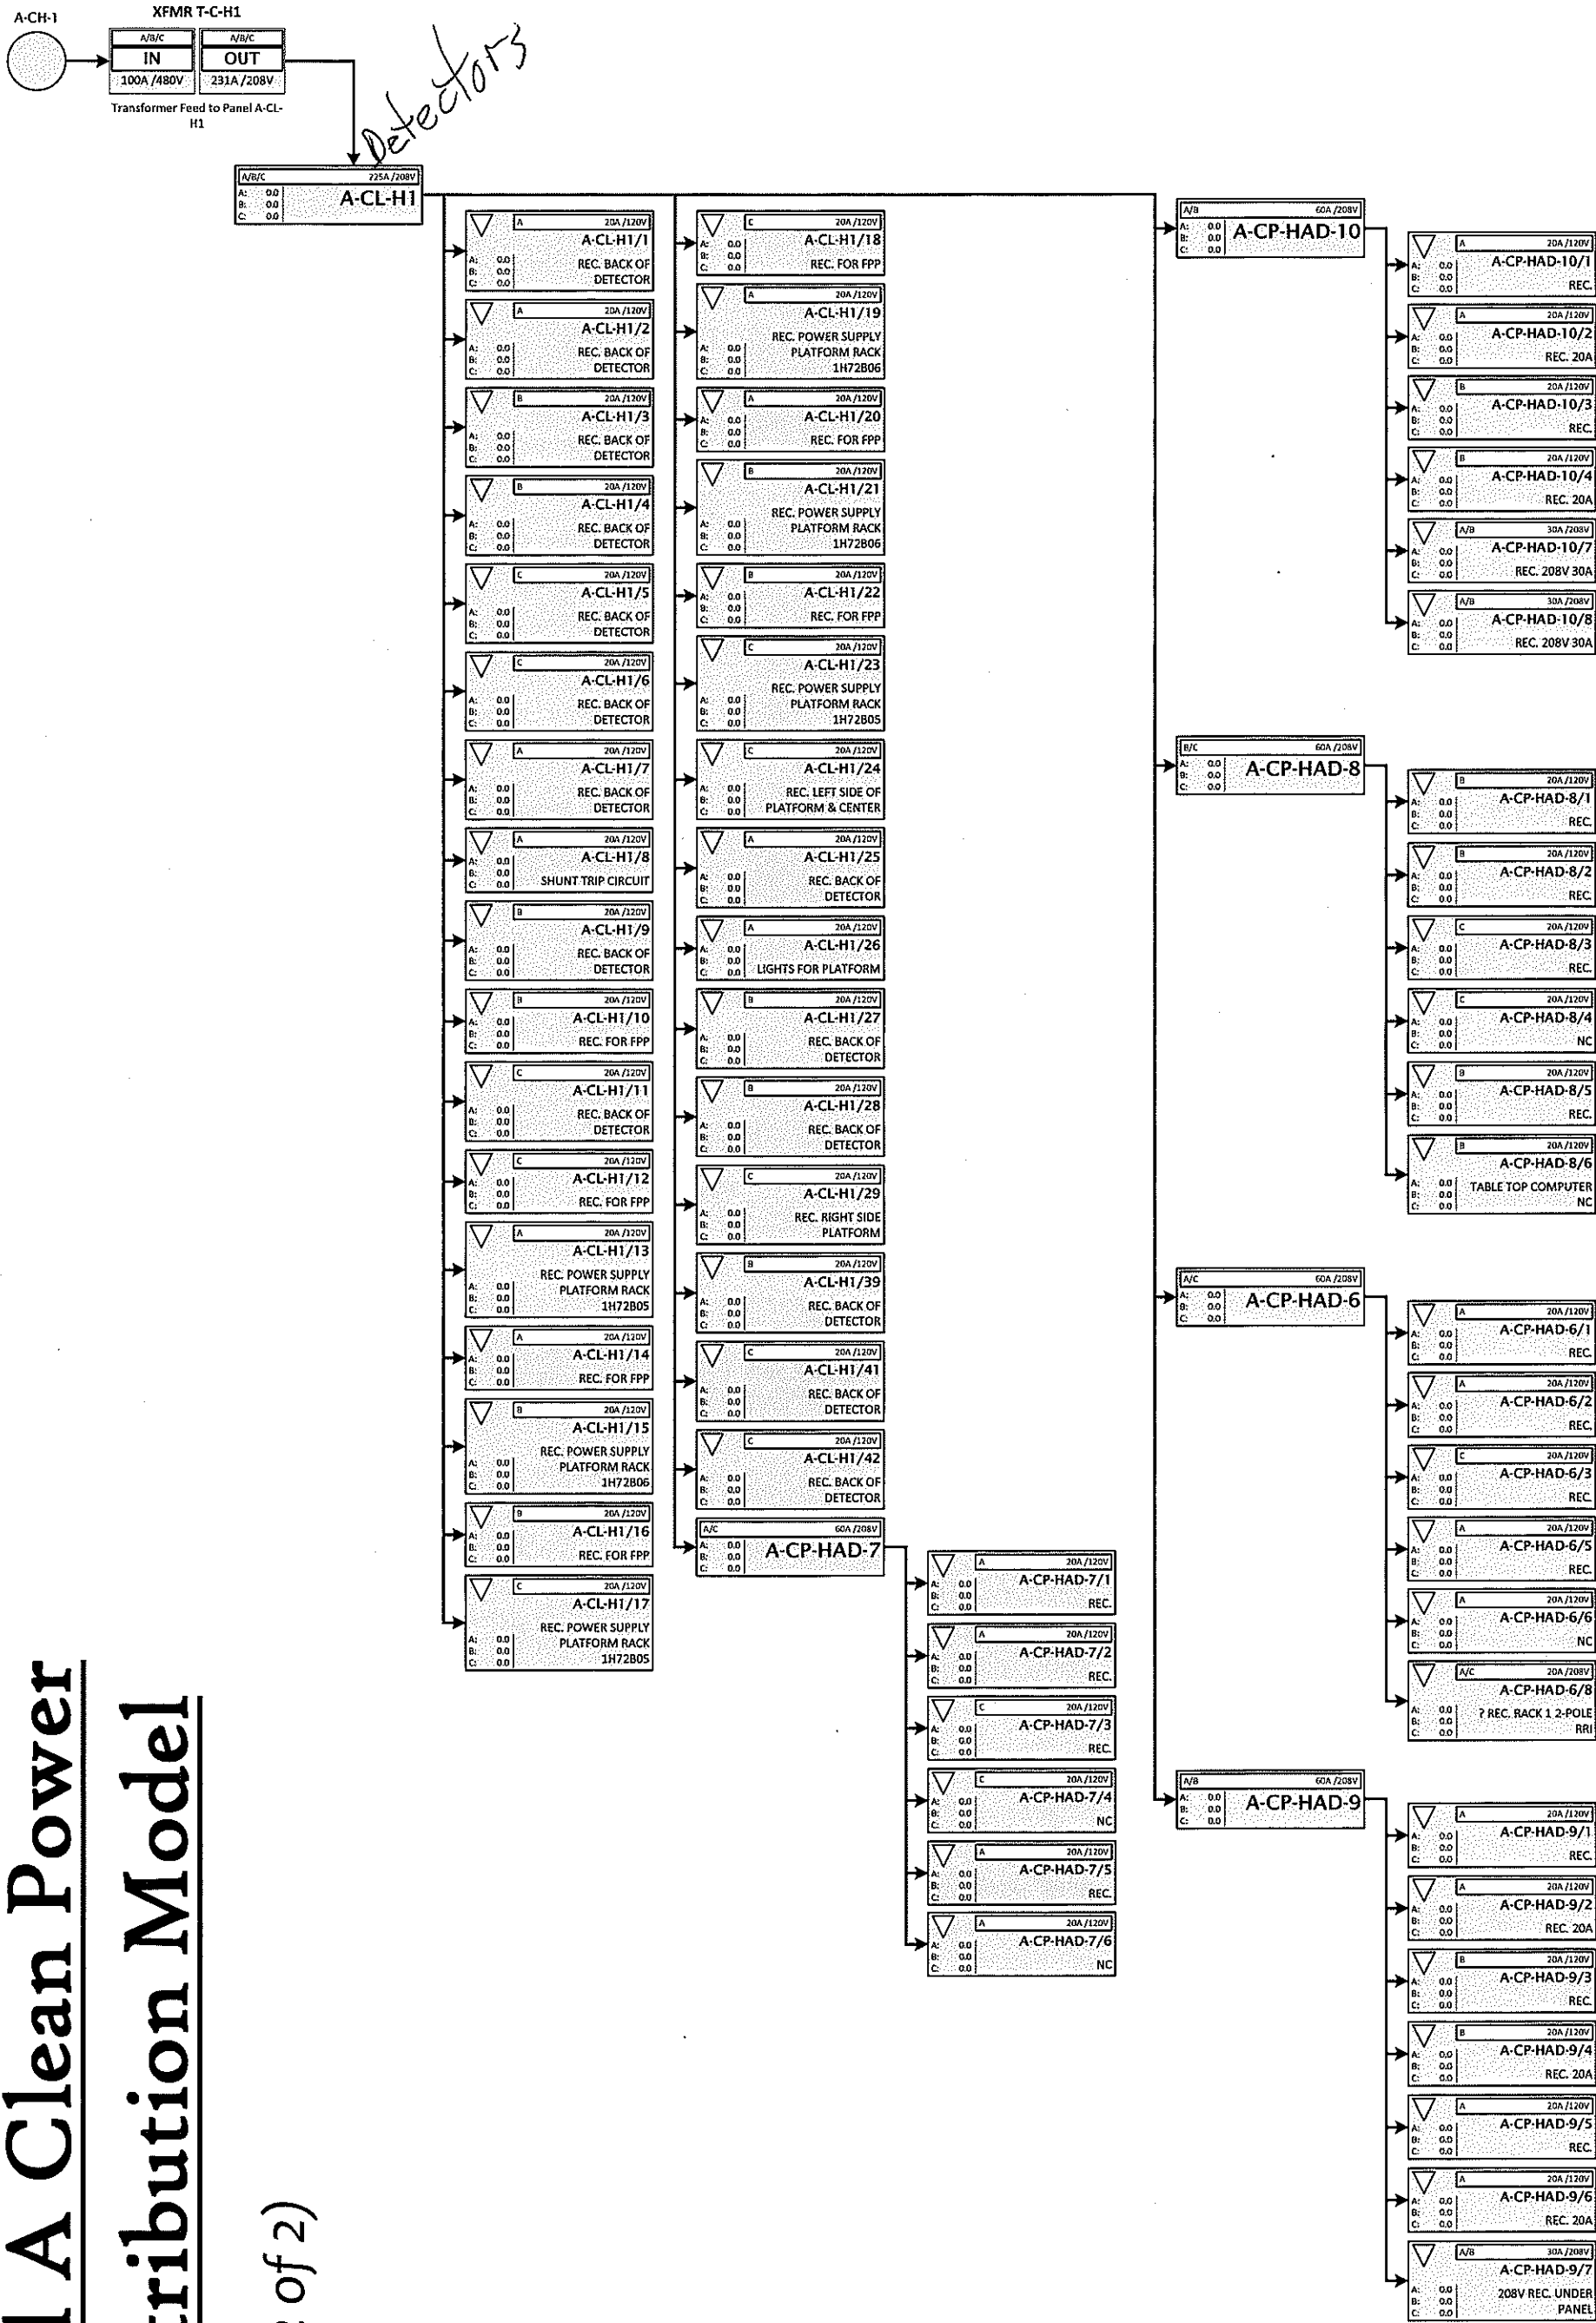


Hall A Utility Power Distribution Model

(Page 1 of 1)

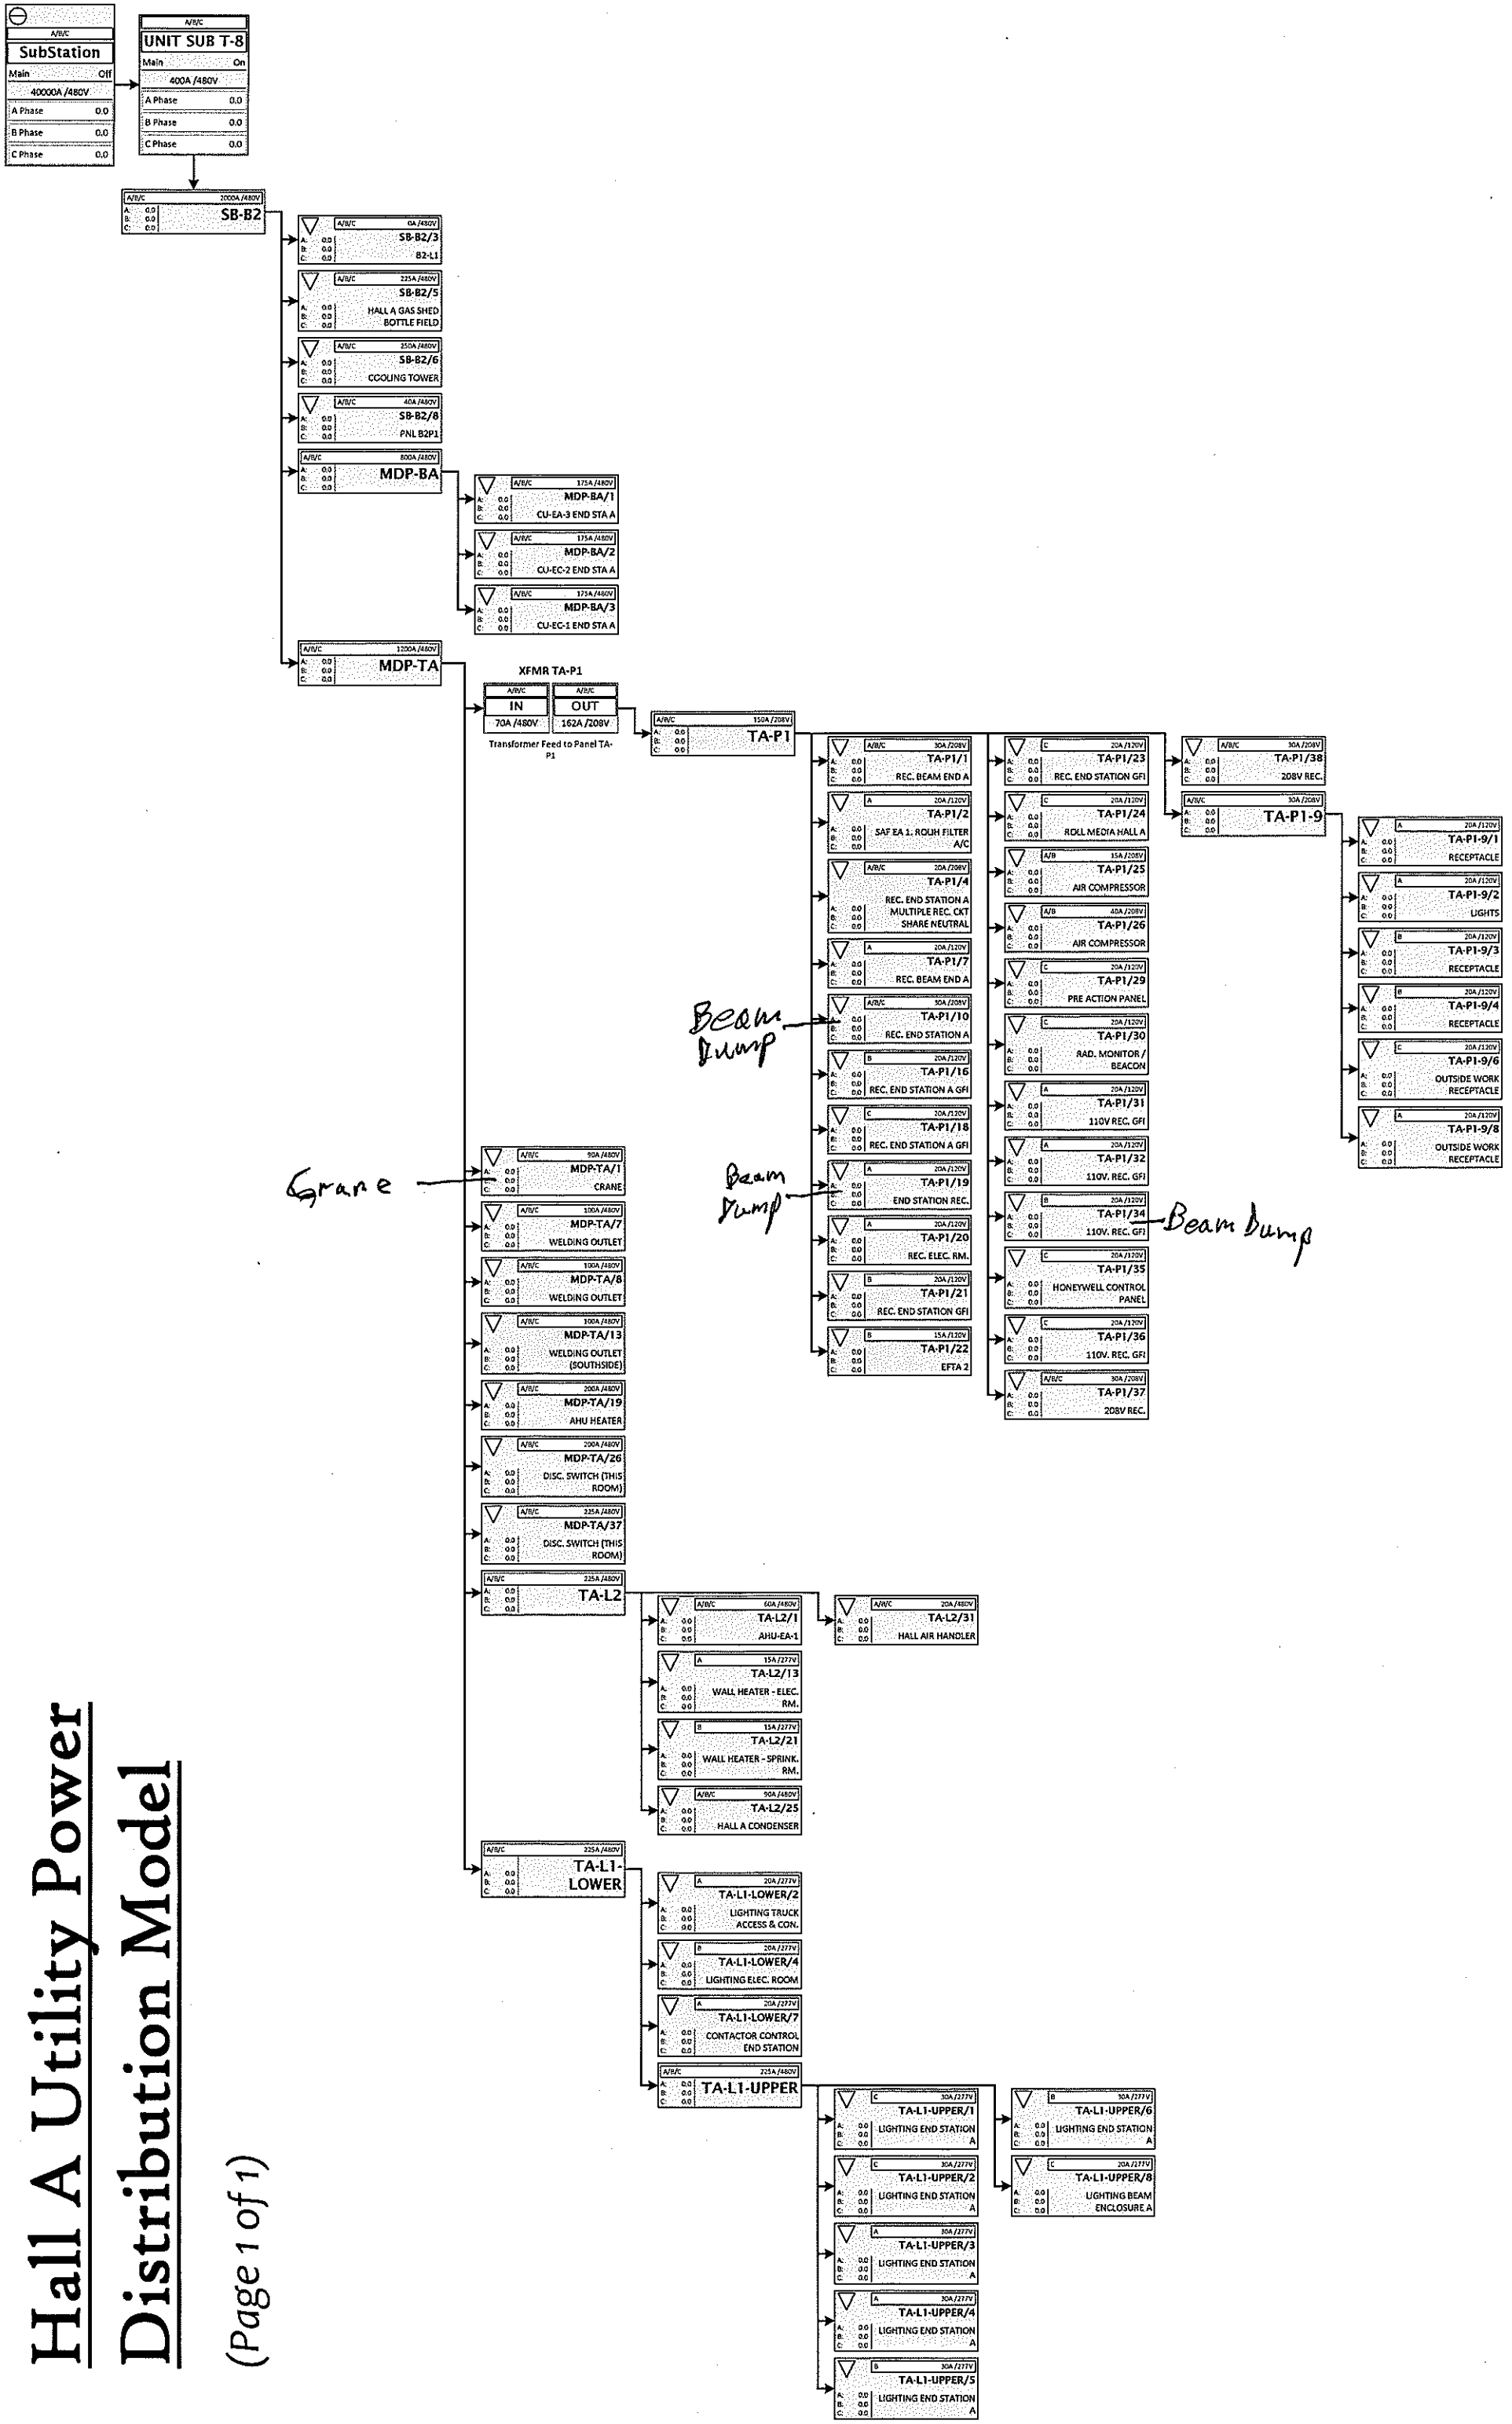

Hall A Emergency Power Distribution Model

(Page 1 of 1)

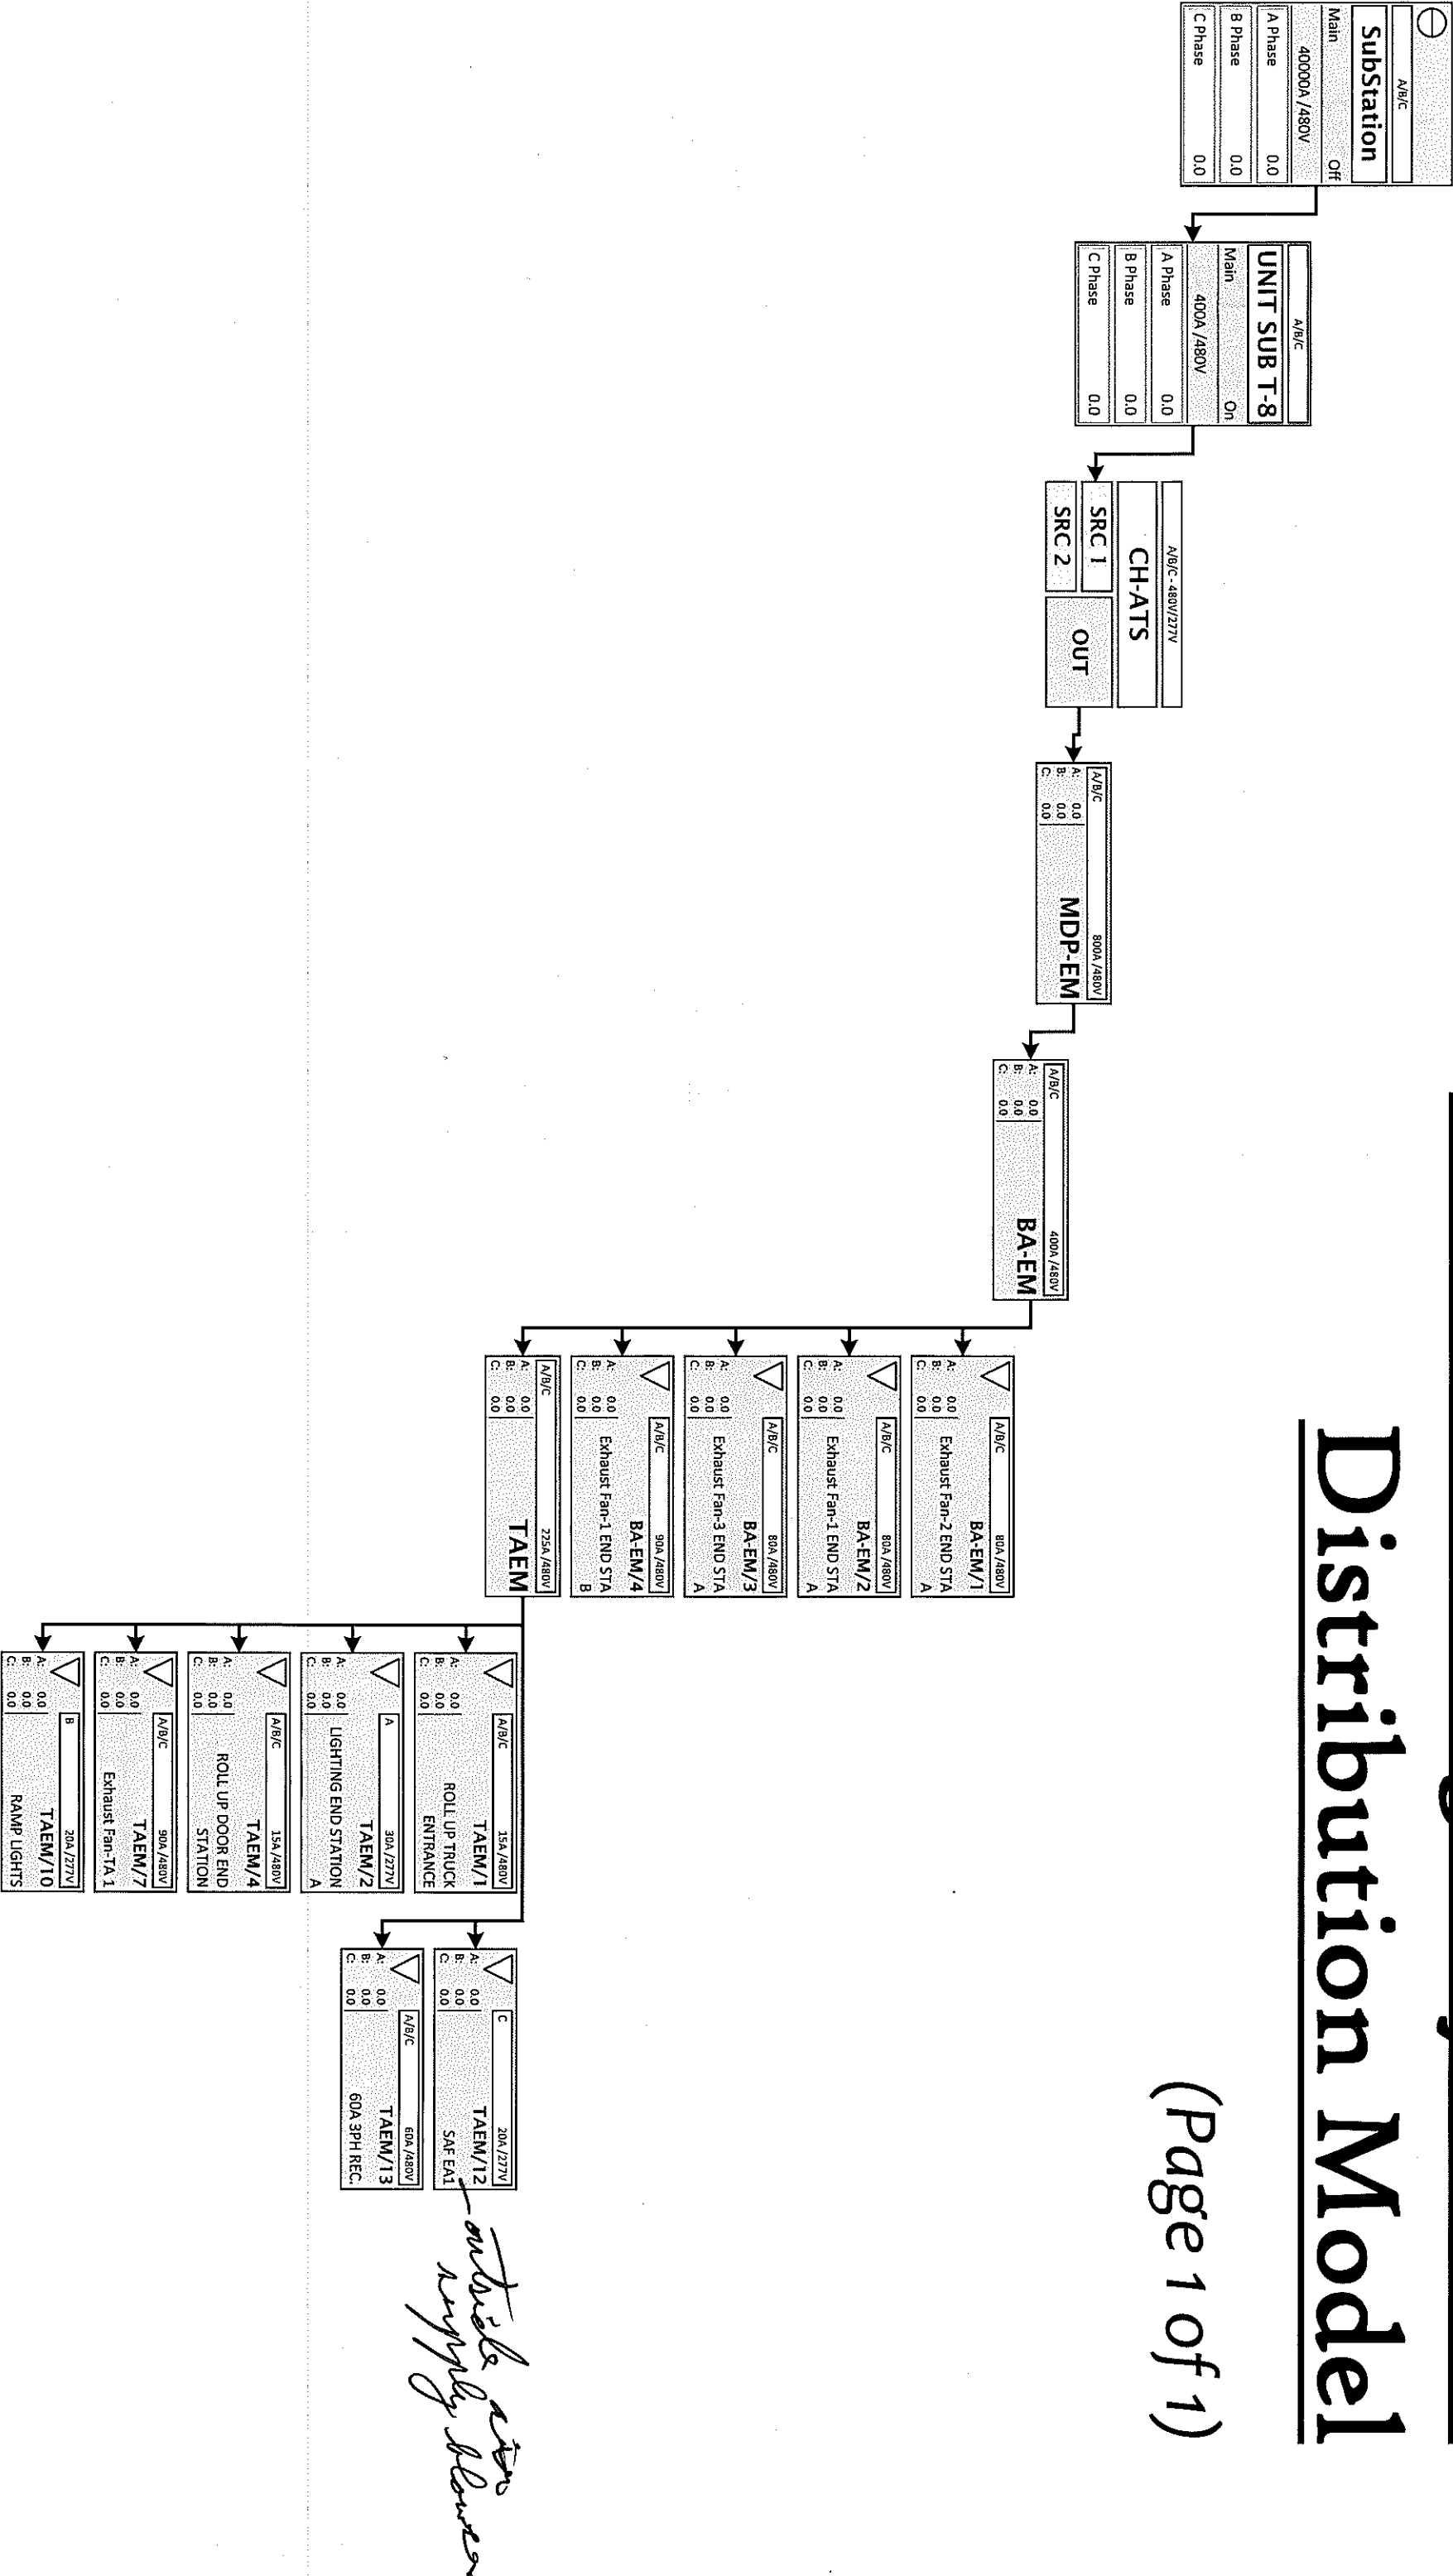

CHP3-19 ^{network} Cryo & controls & Target

CHP3-35 BLMs by Lora & ODH by door & interlock keys
"Hall A Safety"

CHP3/17 } Tritium
CHP3/41 }

CHP3/17 cellphones in halls

Done

outer wall
beamline racks
labyrinth
downstream beamline