

WARM HELIUM RETURN
300K, 1.1 atm

MRS DIPOLE COIL / CRYOSTAT CRYOSTAT SCHEMATIC 9/94


Legend:

Instrumentation

LL = Liquid Level Gauge
FI = Flow Indicator
PT = Platinum Temp. Ω
SD = Silicon Diode Temp
VI = Voltage Indicator
GP = Gas Purity Monitor

Cryogenics

WLN = WeKa, Liquid Nitrogen
WTF = WeKa, Top Fill
WBF = WeKa, Bottom Fill
WGR = WeKa, (cold) Gas Return
(C) = CEBAF Supplied

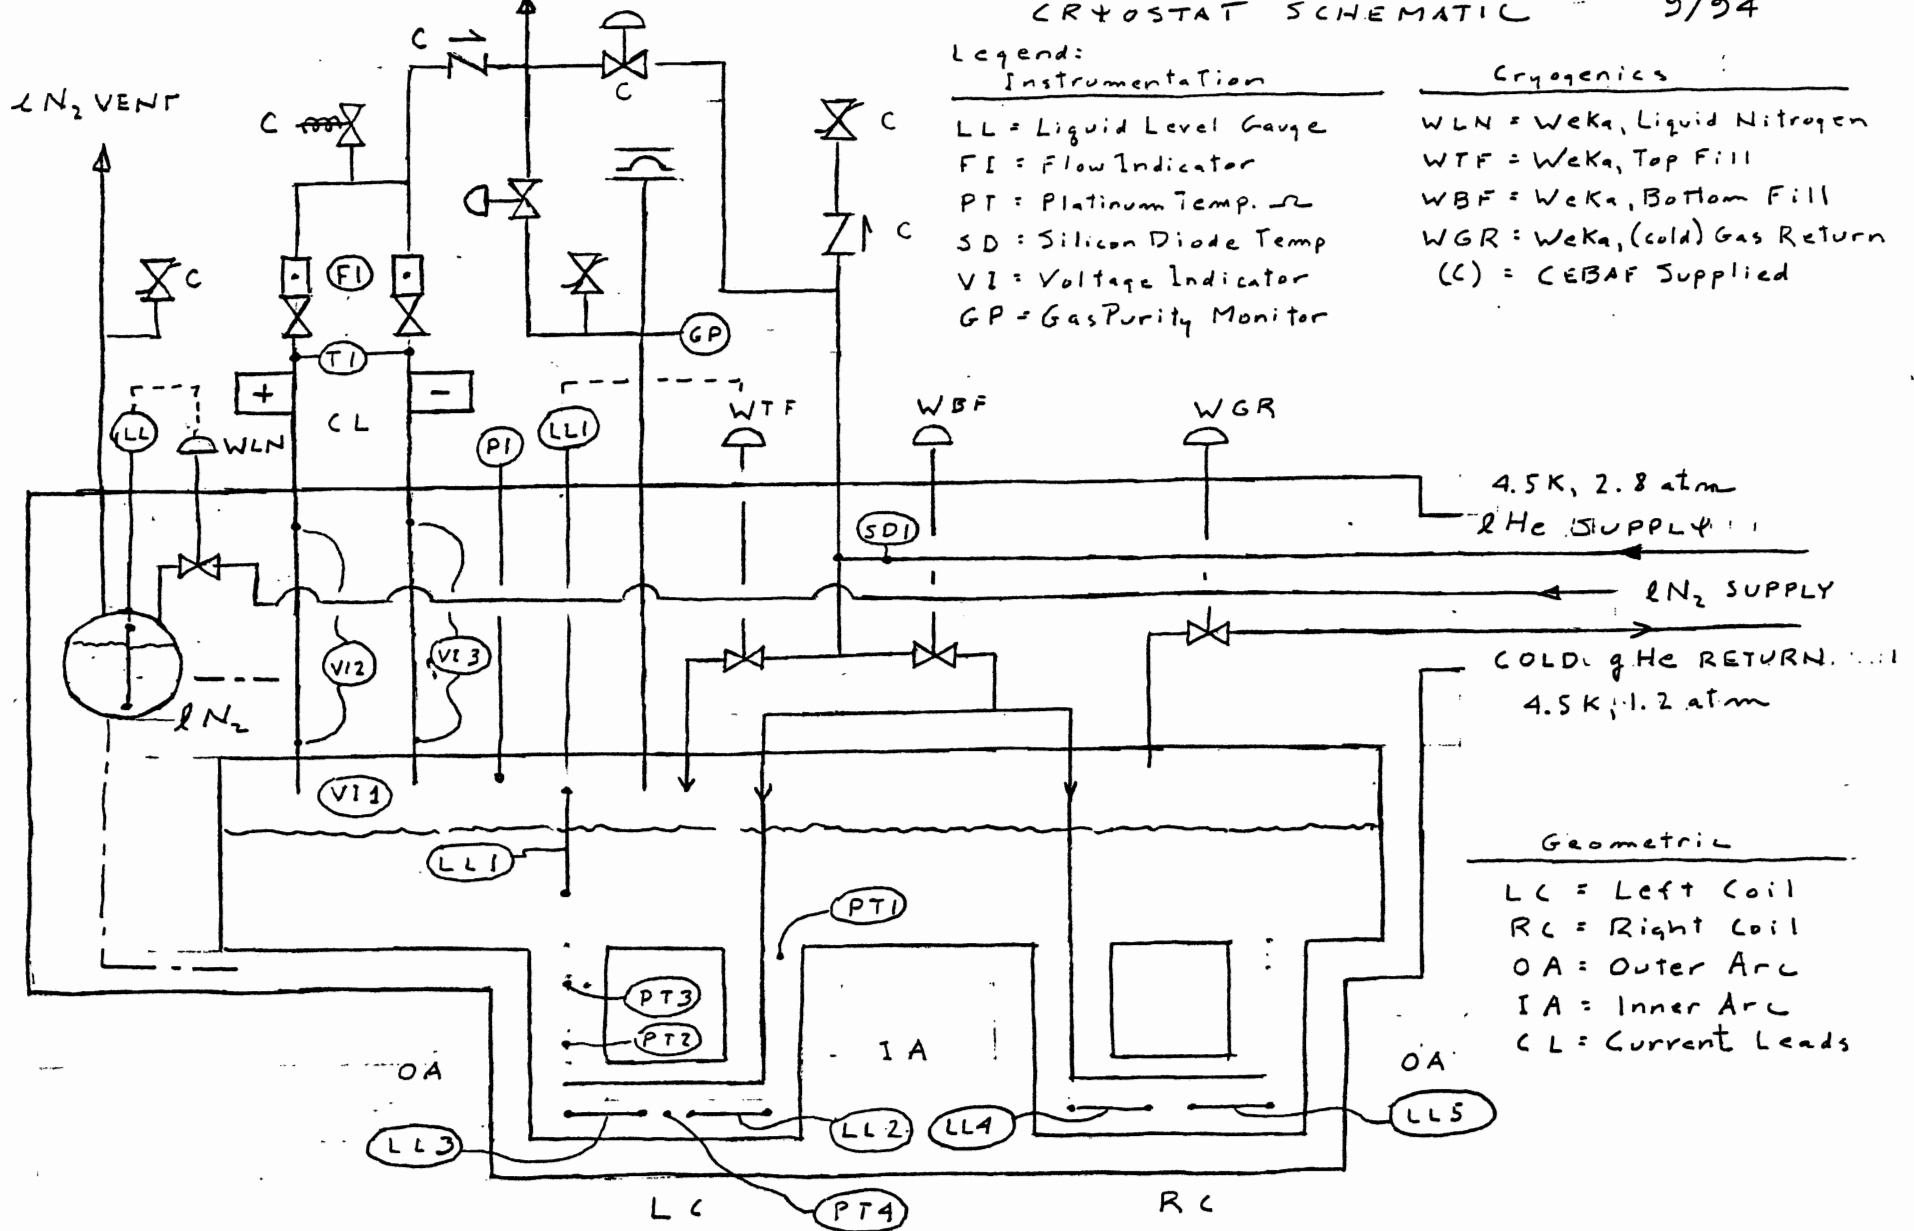

SD 2 ?
see P. A-77 of FDR, Vol I