


J. Gomey Garmendia

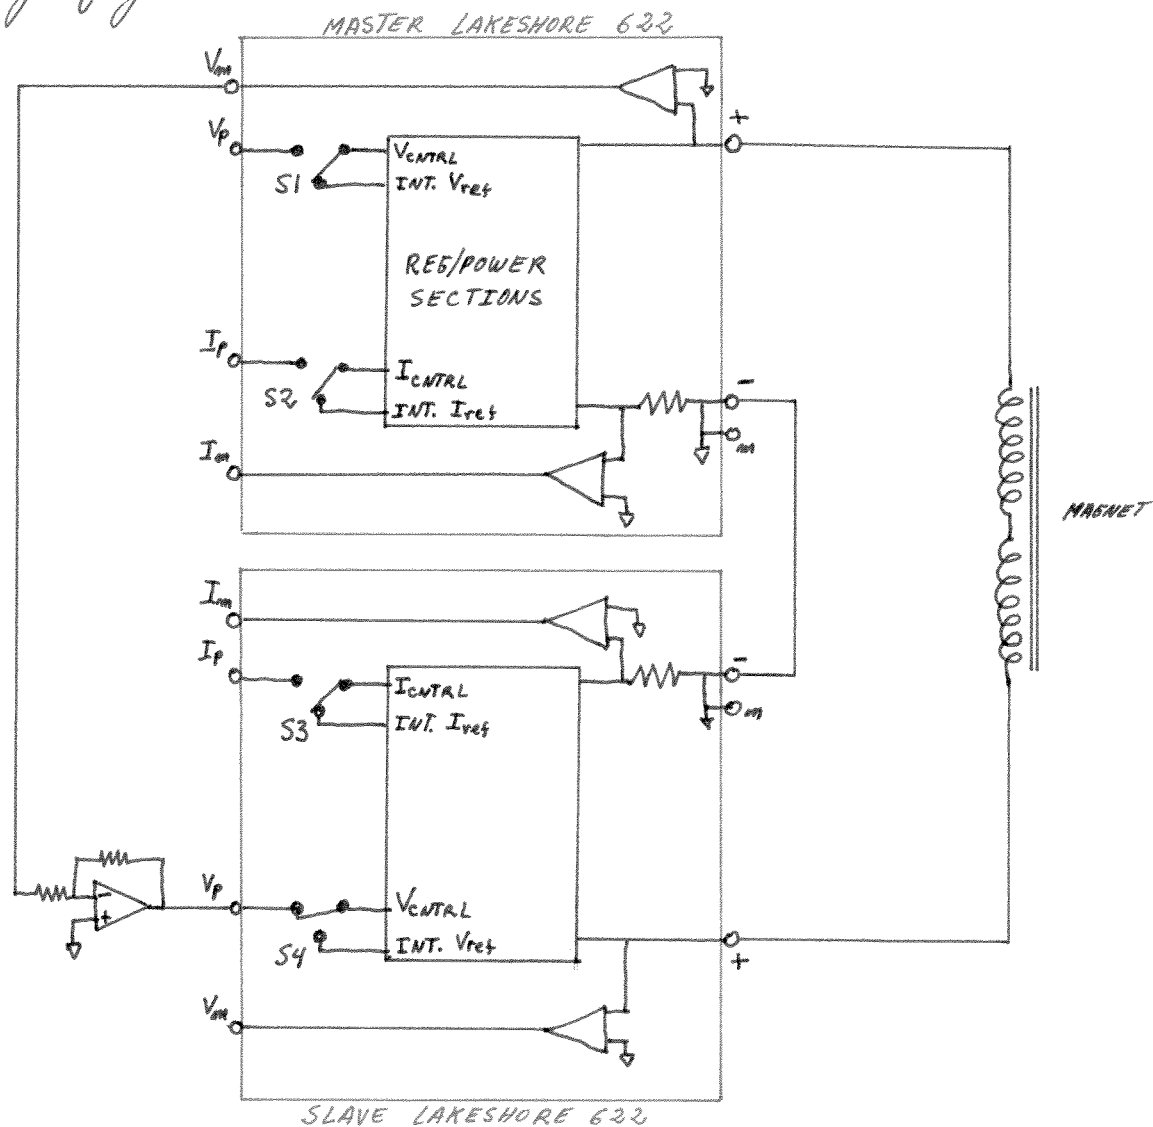

NOTES

- (i) S_1 : V-EXT/INT switch - set to INT.
- (ii) S_2 : I-EXT/INT switch - set to INT.
- (iii) S_3 : I-EXT/INT switch - set to INT.
- (iv) S_4 : V-EXT/INT switch - set to EXT.

● Operation

- (i) Master LakeShore operates in current regulation mode with internal reference.
 - (ii) Slave LakeShore operates in voltage regulation mode with external reference
- ⇒ The two power supplies were operated in this mode without any problems.