


REVISIONS

7. TEST ANCHORS AS FOLLOWS:

ANCHOR DIA. (IN)	WEDGE		SLEEVE		SHELL	
	LOAD (LBS)	TORQUE (FT-LBS)	LOAD (LBS)	TORQUE (FT-LBS)	LOAD (LBS)	TORQUE (FT-LBS)
1/4	800	10	400	4	1000	-
5/16	-	-	400	5	1400	-
3/8	1000	25	100	10	1800	-
1/2	2000	50	90	20	2700	-
5/8	2300	80	1100	45	3700	-
3/4	3700	150	1400	90	5400	-
1	5800	250	-	-	-	-

- e. IF ANY ANCHOR FAILS TESTING, TEST ALL ANCHORS OF THE SAME CATEGORY NOT PREVIOUSLY TESTED UNTIL TWENTY (20) CONSECUTIVE PASS, THEN RESUME THE INITIAL TESTING FREQUENCY.

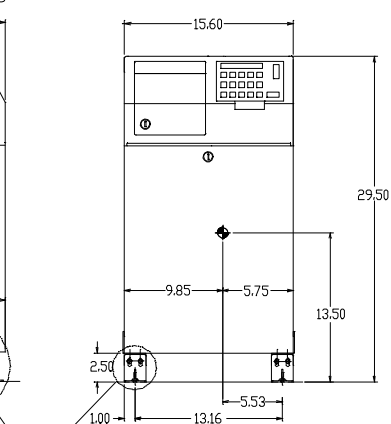

FE 4.3KVA		
SEISMIC ANCHORAGE, CENTER OF GRAVITY		
SIZE	DWG NO.	REV
B	2676 G01	D
SCALE: NONE		SHEET 1 OF 2