


TOP VIEW


LOCATION OF CONNECTION TO WASTE
CONDENSER WATER BACK FLOW
PREVENTER(NOT INCLUDED) THIS
CONNECTION IS REQUIRED FOR
WATER COOLED UNITS ONLY.

GENERAL NOTES

1. ALL DIMENSIONS ARE IN INCHES [MM].
2. ALLOW 4 INCHES [102] MIN.
PER SIDE FOR VENTILATION.
3. IT IS RECOMMENDED THAT ALL WATER
OUTLETS BE NOT MORE THAN 7 FEET FROM
THE CHILLER AND ALL COLD WATER PIPING
BE COVERED WITH SPONGE RUBBER OR
ICE WATER TYPE INSULATION OF
ADEQUATE THICKNESS.

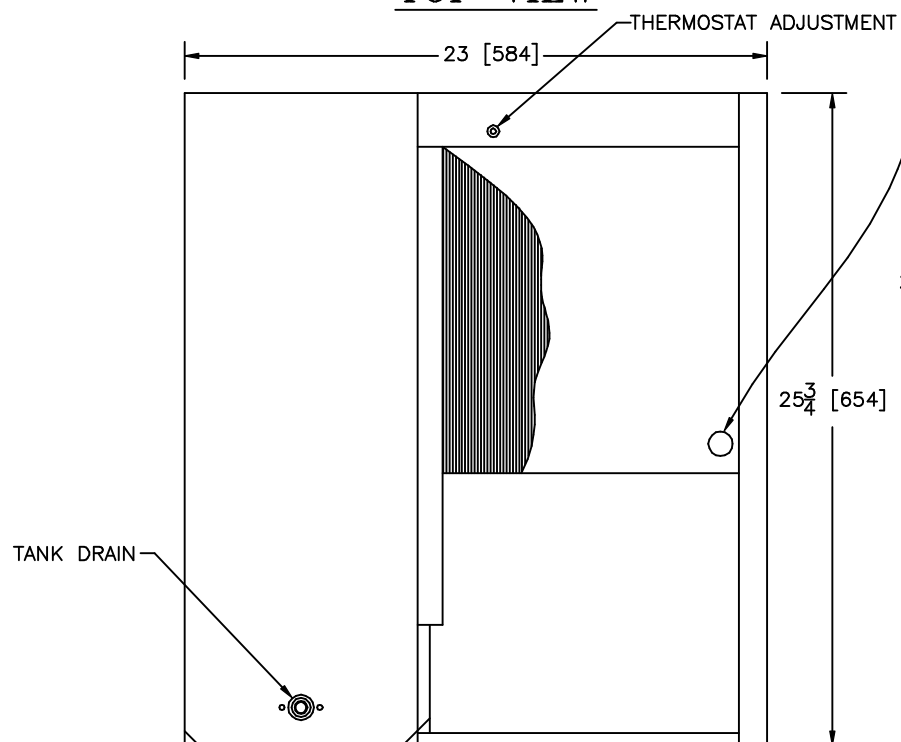

FRONT VIEW

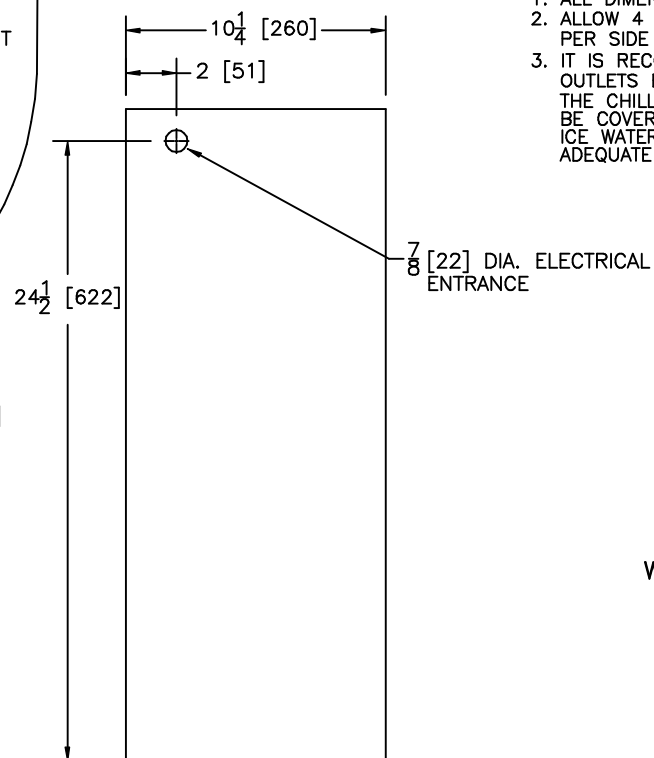

SIDE VIEW

REMOTE
WATER CHILLERS
RP
C026415-14